


## ABSTRACT

Test Material:	<b>ULTRA PLUS</b>
Test Standard:	<b>ASTM E84-91a Standard Test Method for SURFACE BURNING CHARACTERISTICS OF BUILDING MATERIALS (ANSI 2.5, NFPA 255,</b>
Test Date:	<b>July 12, 1994</b>
Test Sponsor:	<b>United Industries</b>
Test Results:	<b>FLAME SPREAD INDEX = 40 SMOKE DEVELOPED INDEX = 660</b>

The description of the test procedure and specimen evaluated, as well as the observations and results obtained, contained herein are true and accurate within the limits of sound engineering practice.

**Omega Point Laboratories, Inc. authorizes the client named herein to reproduce this report only if reproduced in its entirety.**

**The test specimen identification is as provided by the client and Omega Point Laboratories accepts no responsibility for any inaccuracies therein.**

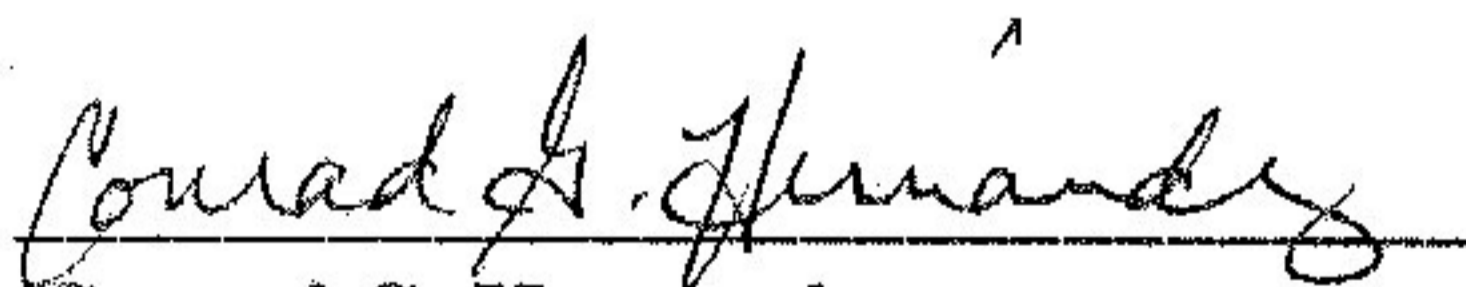

Conrad G. Hernandez

Test Engineer

Date: July 19, 1994



William E. Fitch, P.E. No. 55296

Executive Vice President

Date: July 19, 1994

